
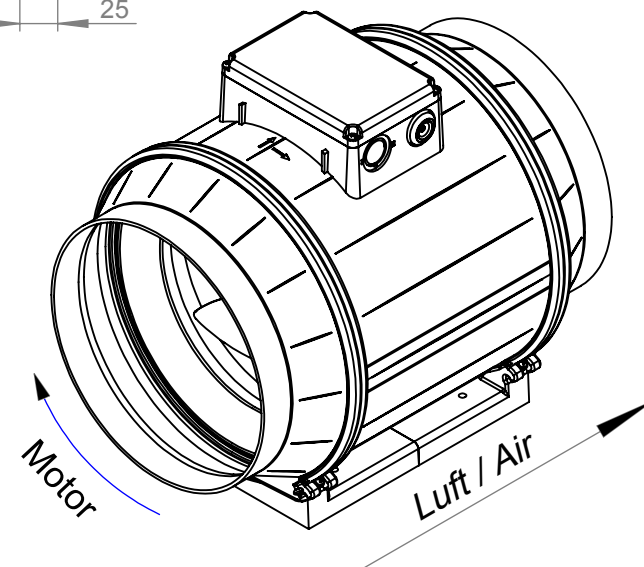
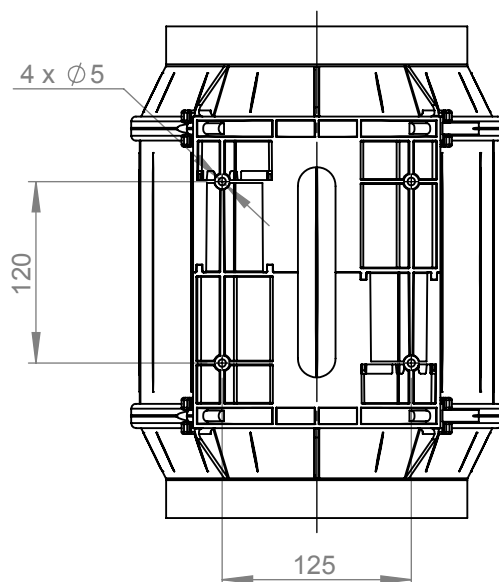
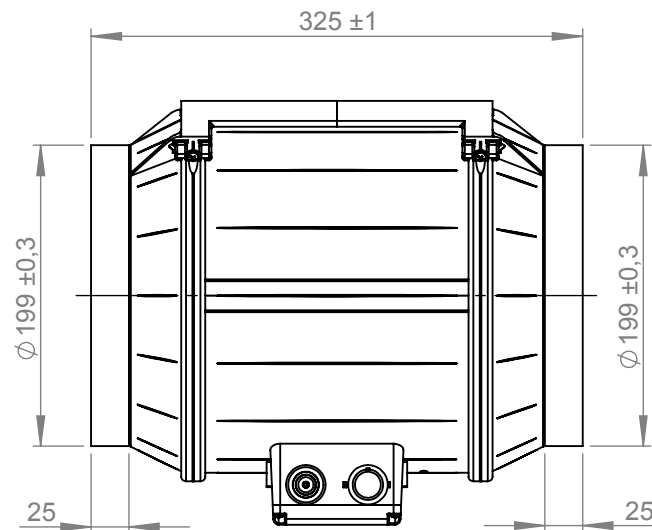


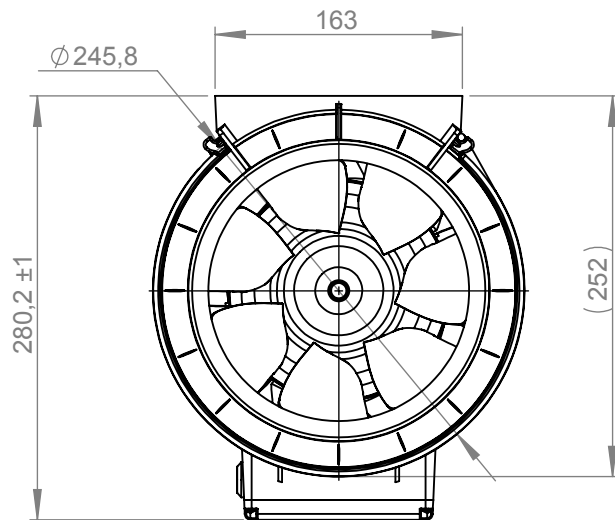

Protection Mark
according to ISO 16016

1:5 A4 mm

General tolerances
DIN ISO 2768-c

EM200E2M01+

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created m.deissler 26.09.2013
Drawn m.deissler 26.09.2013
Released
Disabled

127249 02